


PLAN  
SCALE N.T.S

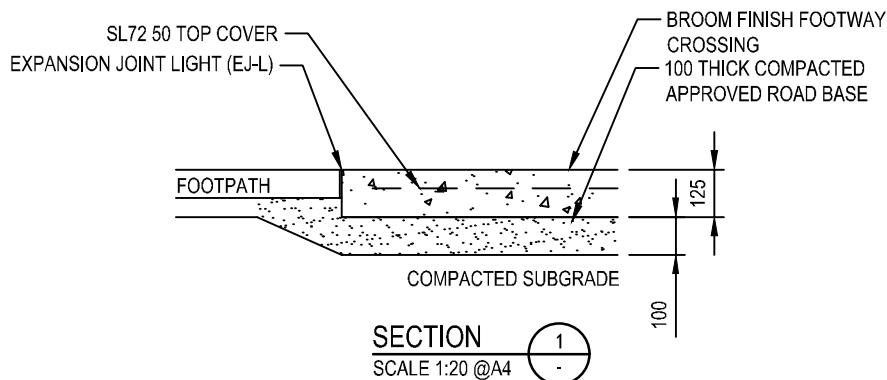

SECTION  
SCALE 1:20 @A4

**NOTES:**

1. LIGHT DUTY FOOTPATH CROSSINGS ARE TYPICALLY USED FOR RESIDENTIAL PROPERTIES.
2. FOOTPATH CROSSINGS SHALL CONSIST OF 125mm THICK BROOM FINISHED REINFORCED CONCRETE WITH SL72 OVER 100mm THICK OF APPROVED ROADBASE.
3. REFER TO CIV.11 FOR JOINT DETAIL.
4. CONCRETE EDGES SHALL BE FINISHED WITH AN EDGING TOOL.
5. CONCRETE SHALL HAVE A 28 DAY STRENGTH OF 25MPA MINIMUM.
6. CONCRETE SHALL BE PLACED WITH A MAXIMUM SLUMP OF 80mm.
7. MINIMUM CONCRETE COVER SHALL BE 40mm UNLESS NOTED OTHERWISE.
8. THE COUNCIL ENGINEER REQUIRES 24 HOURS NOTICE PRIOR TO POURING OF CONCRETE TO INSPECT THE FORMWORK. NO CONCRETE SHALL BE POURED UNTIL THE EXCAVATION AND FORMWORK HAVE BEEN INSPECTED.
9. REFER TO CIV.5 SERIES FOR STANDARD FOOTPATH DETAILS.
10. ALL DIMENSIONS IN MILLIMETRES UNLESS NOTED OTHERWISE .

COPYRIGHT © 2011 City of Ryde - ALL RIGHTS RESERVED  
No part of this document shall be modified or reproduced without written permission.  
Go to [www.ryde.nsw.gov.au/disclaimer](http://www.ryde.nsw.gov.au/disclaimer) to view the Standard Drawings Disclaimer



STANDARD DRAWING  
**STANDARD  
FOOTWAY CROSSING  
(REINFORCED)**

APPROVED VP DESIGN MANAGER	DATE 16/06/18
DRAWING NUMBER CIV.4.2	REVISION D